



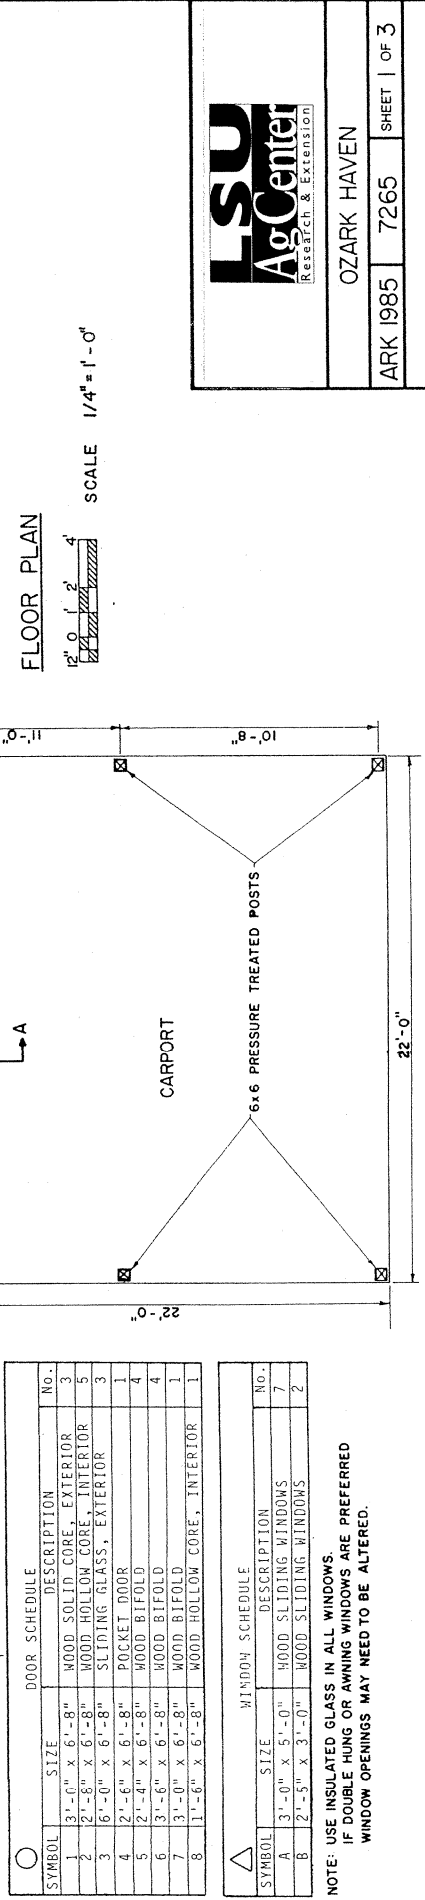


△ WINDOW SCHEDULE			
SYMBOL	SIZE	DESCRIPTION	No.
A	3'-0" x 5'-0"	WOOD SLIDING WINDOWS	7
C	0'-0" x 0'-0"	WOOD SLIDING WINDOWS	2

NOTE: USE INSULATED GLASS IN ALL WINDOWS.
IF DOUBLE HUNG OR AWNING WINDOWS ARE PREFERRED
WINDOW OPENINGS MAY NEED TO BE ALTERED.

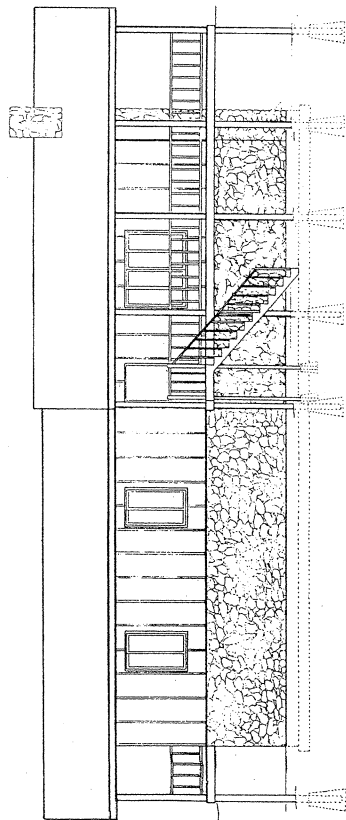


FRONT ELEVATION

12'0" 1' 4" 1" SCALE 1/8" = 1'-0"

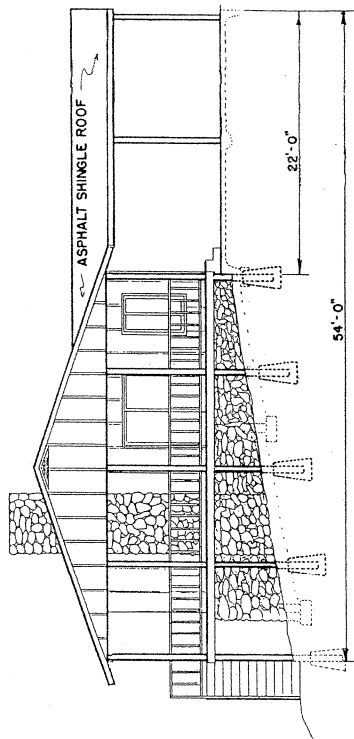


RIGHT ELEVATION

12'0" 1' 4" 1" SCALE 1/8" = 1'-0"

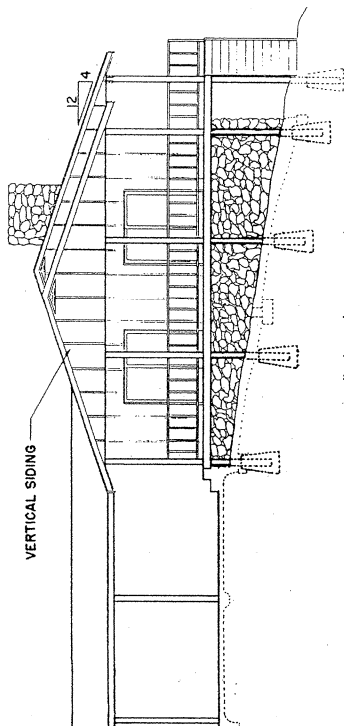


LEFT ELEVATION

12'0" 1' 4" 1" SCALE 1/8" = 1'-0"

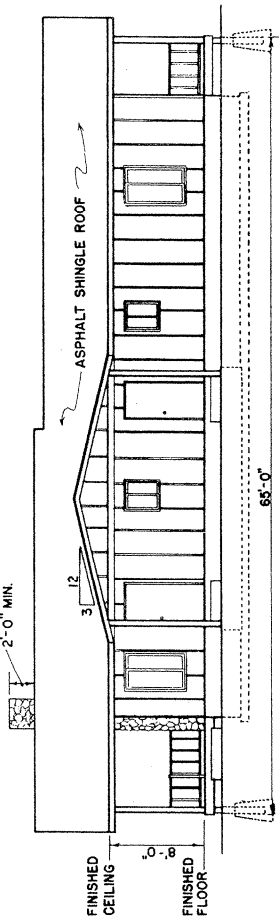


REAR ELEVATION

12'0" 1' 4" 1" SCALE 1/8" = 1'-0"

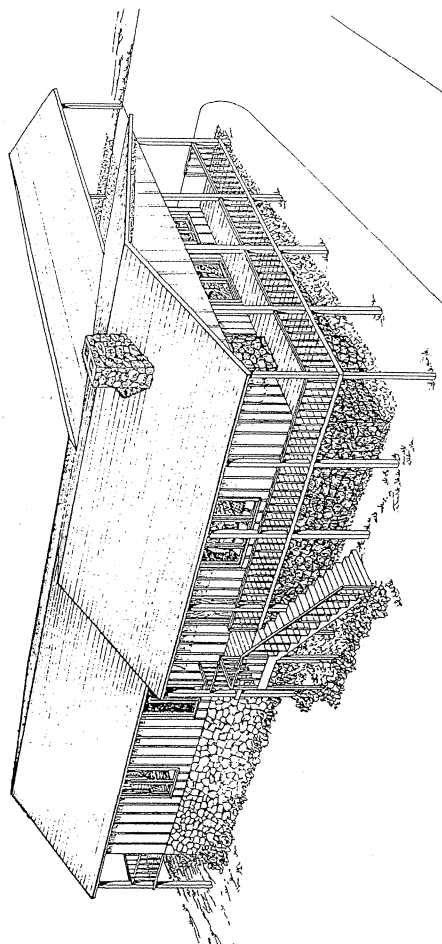


PERSPECTIVE (NOT TO SCALE)

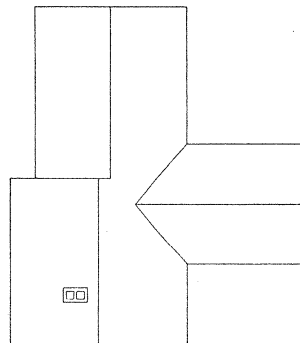

ROOF PLAN
(NOT TO SCALE)

CONSTRUCTION CHECK LIST

1. CHECK LOCAL BUILDING CODE AND LOAN COMPANY CRITERIA PURCHASE TRUSSES ACCORDING TO LOCAL SNOW LOAD CRITERIA.
2. ADEQUATELY NAIL AND ANCHOR JOINTS.
3. SHEATH CORNERS WITH 1/2" PLYWOOD OR HIGH DENSITY FIBERBOARD OR USE DIAGONAL BRACING.
4. USE EXTERIOR GLUED PLYWOOD WHEREVER IT MAY BE WETTED DURING OR AFTER CONSTRUCTION.
5. PRESSURE TREAT ALL WOOD WITH GROUND CONTACT AND PROVIDE OTHER NEEDED TERMITE CONTROL.
6. R VALUES DEPEND ON LOCAL CLIMATE AND FUEL COSTS.
7. PROVIDE 1 SQ. FT. OF VENT OPENINGS FOR EACH 150 SQ. FT. OF CEILING.
8. WEATHERIZE ALL OPENINGS AND JOINTS.
9. DOUBLE JOISTS UNDER TUBS AND OTHER HEAVY LOADS.

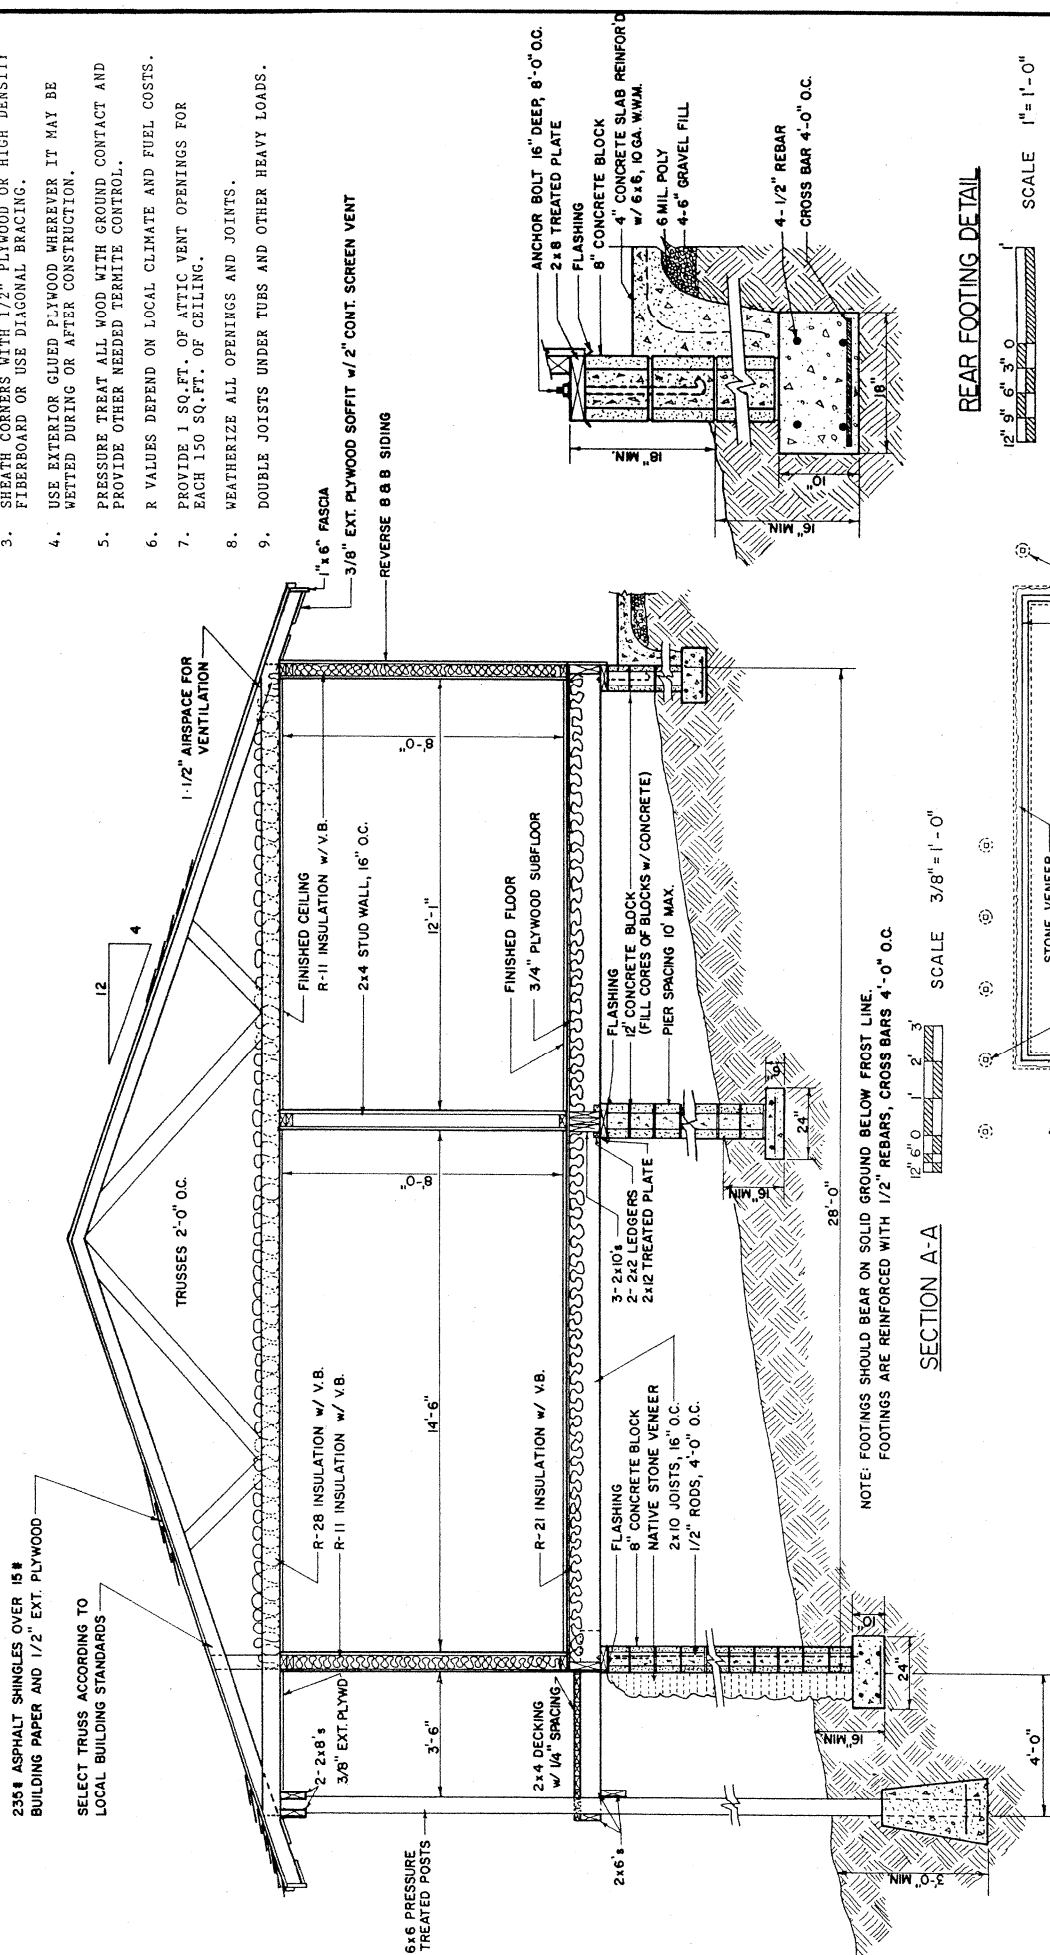

SECTION A-A


NOTE: FOOTINGS SHOULD BEAR ON SOLID GROUND BELOW FROST LINE.
FOOTINGS ARE REINFORCED WITH 1/2" REBARS, CROSS BARS 4'-0" O.C.



SCALE $3/8" = 1' - 0"$




STONE VENEER
POST FOOTINGS 9'-4" O.C.
POST FOOTINGS 8'-0" O.C.

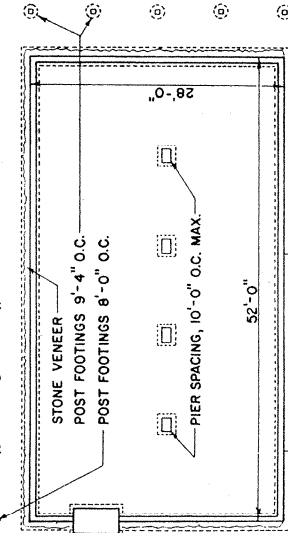


FOUNDATION PLAN


5" x 3'-6" x 6'-0"
CONCRETE SLAB
UNDER CHIMNEY



SCALE $3/32" = 1' - 0"$



REAR FOOTING DETAIL



SCALE 1"=1'-0"



OZARK HAVEN

ARK 1985	7265	SHEET 3 OF 3
----------	------	--------------