


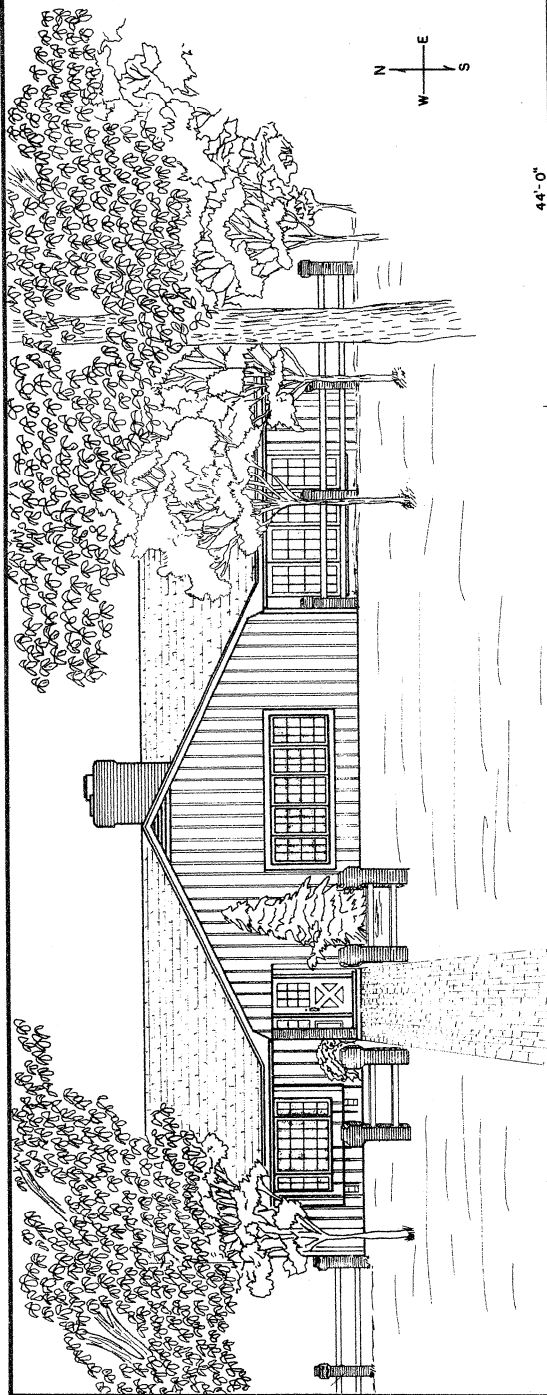

SOUTH ELEVATION

12'0" 1' 4" SCALE 1/8" = 1' - 0"


SQUARE FOOTAGE

HEATED SPACE - 2,739 SQ. FT.
GARAGE - 637 SQ. FT.
PORCH - 96 SQ. FT.
TOTAL - 3,472 SQ. FT.

SYMBOL	SIZE	DESCRIPTION	NO.
1	7'-0" x 20'-0"	GARAGE DOOR w/MULTI-LITE TOP	1
2	3'-0" x 6'-8"	EXT. DR. w/MULTI-LITE TOP & L. SIDE LITE	1
3	2'-6" x 6'-8"	INT. PANEL DOOR	4
4	3'-0" x 6'-8"	CASED OPENING	3
5	4'-0" x 6'-8"	BI-FOLD DOOR	1
6	2'-6" x 6'-8"	"	2
7	6'-0" x 6'-8"	"	3
8	3'-0" x 6'-8"	INT. PANEL DOOR	3
9	3'-0" x 6'-8"	EXT. DOOR w/MULTI-LITE TOP	2
10	2'-6" x 6'-8"	INT. DOOR	2
11	2'-6" x 6'-8"	INT. POCKET DOOR	3
12	2'-6" x 6'-8"	FOUR PANEL EXT. ATRIUM DOOR w/FIXED RIGHT & LEFT SIDE DIVIDED LITES	2
13	12'-0" x 6'-8"	INT. BATHTUB	1

SYMBOL	SIZE	DESCRIPTION	NO.
△	2'-6" x 5'-0"	FIVE UNIT CASEMENT	2
A	8'-0" x 4'-0"	COMB. CASEMENT w/5'-0" x 4'-0" PICTURE WINDOW & 1'-6" x 4'-0" LEFT & RIGHT CASEMENT	2
C	2'-6" x 5'-0"	CASEMENT	6
D	2'-6" x 5'-0"	2-UNIT CASEMENT	1
E	2'-0" x 3'-0"	2-UNIT CASEMENT	1


NOTE: USE INSULATED GLASS IN ALL WINDOWS.

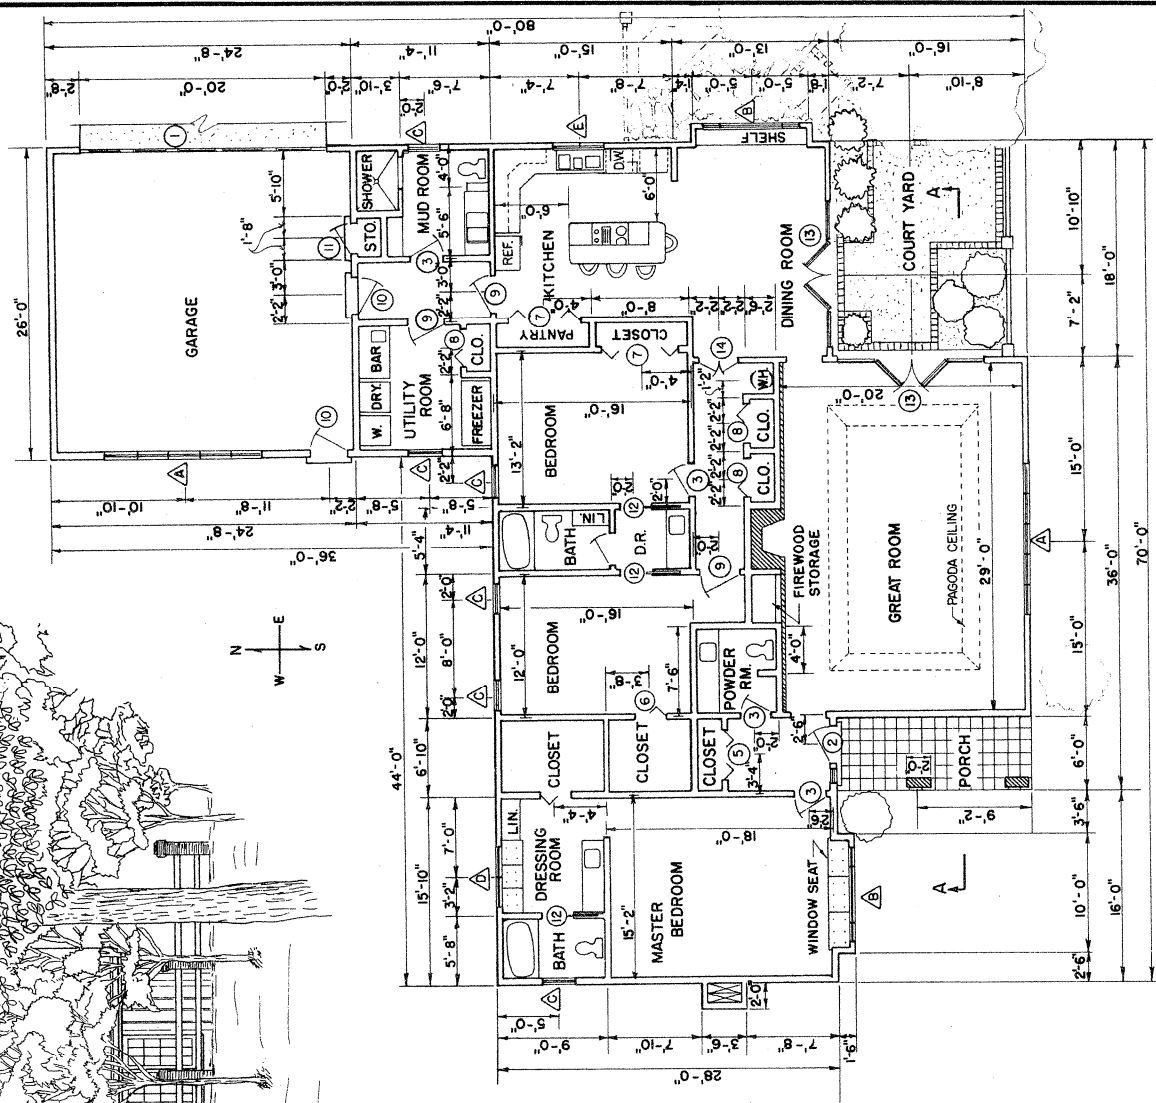

FLOOR PLAN


12'0" 1' 4" SCALE 1/8" = 1' - 0"

NOTE: EXTERIOR DIMENSIONS TO OUTSIDE FACE OF STUDS, UNLESS OTHERWISE SPECIFIED, CLOSETS ARE 2'-3" DEEP.

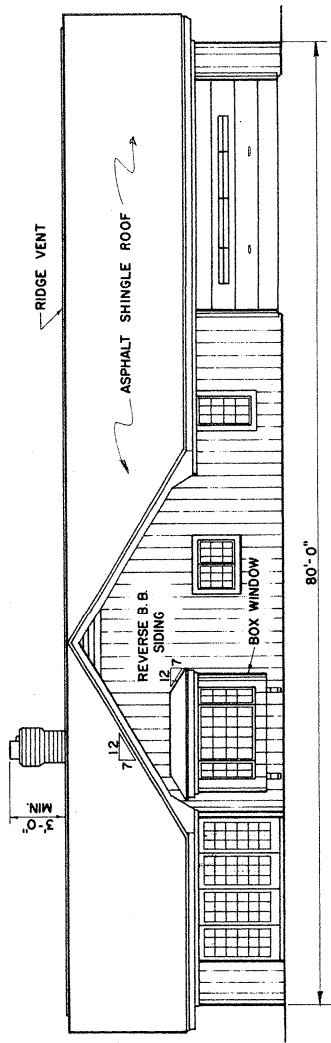


EAST ELEVATION

SCALE 1/8" = 1'-0"

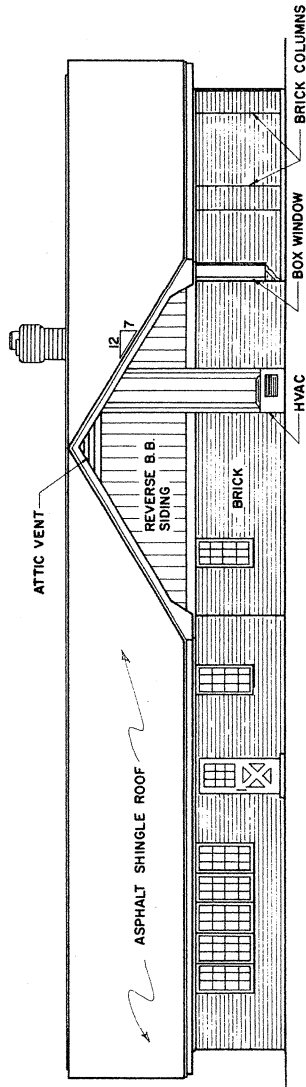


WEST ELEVATION

SCALE 1/8" = 1'-0"

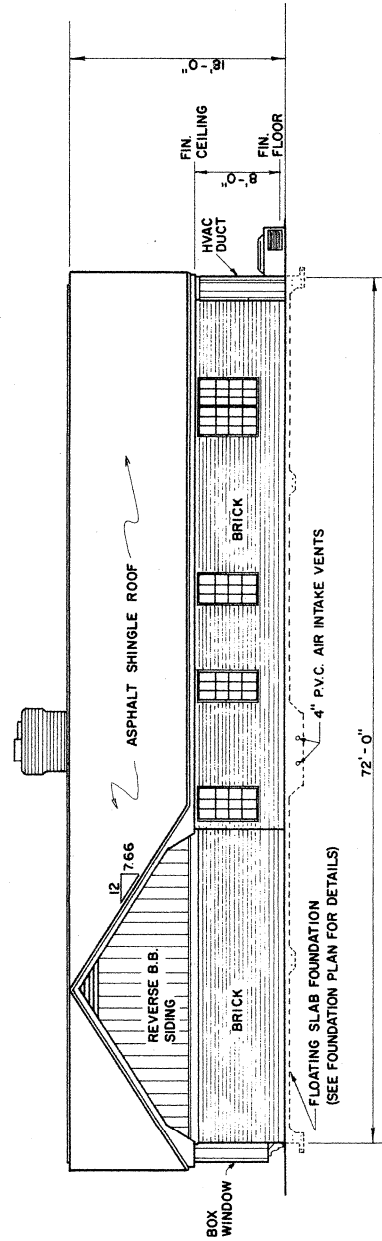


NORTH ELEVATION

SCALE 1/8" = 1'-0"

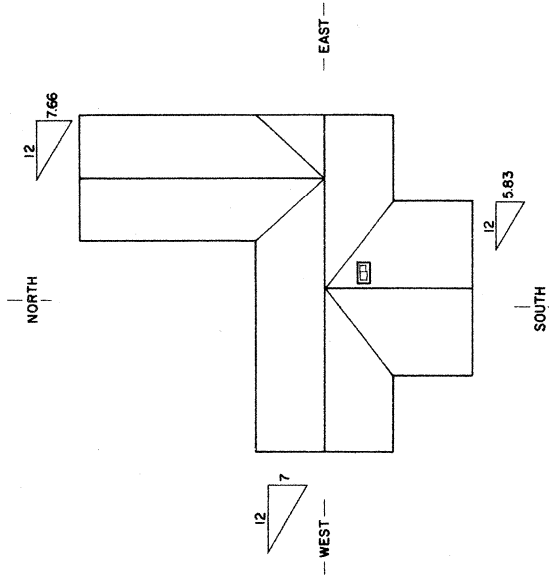

ROOF PLAN
(NOT TO SCALE)

NOTE: FOR OPTIMUM ENERGY EFFICIENCY,
SITE WITH ROOF RIDGE EAST TO WEST.

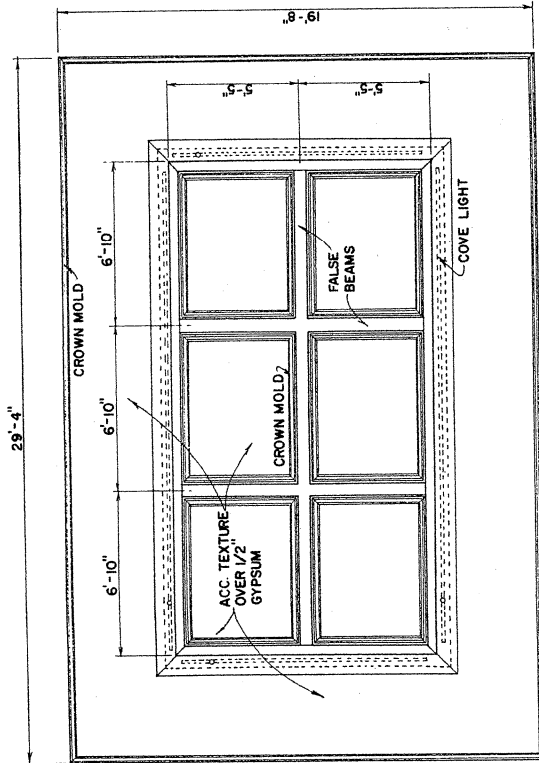



PAGODA CEILING PLAN

SCALE 1/4" = 1'-0"

CONSTRUCTION CHECK LIST





1. CHECK LOCAL BUILDING CODE AND LOAN COMPANY CRITERIA. PURCHASED TRUSSES SHOULD MEET LOCAL SNOW LOAD CRITERIA.
2. ADEQUATELY NAIL AND ANCHOR JOINTS.
3. SHEATH CORNERS WITH 1/2" PLYWOOD OR HIGH DENSITY FIBERBOARD OR USE DIAGONAL BRACING.
4. USE EXTERIOR GLUED PLYWOOD WHEREVER IT MAY BE WETTED DURING OR AFTER CONSTRUCTION.
5. PRESSURE TREAT ALL WOOD WITH GROUND CONTACT AND PROVIDE OTHER NEEDED TERMITE CONTROL.
6. R VALUES DEPEND ON LOCAL CLIMATE AND FUEL COSTS.
7. PROVIDE 1 SQ FT OF ATTIC VENT OPENINGS FOR EACH 150 SQ FT OF CEILING.
8. WEATHERIZE ALL OPENINGS AND JOINTS.
9. MODIFY OR CONSTRUCT TRUSSES AS REQUIRED FOR PAGODA CEILING (SEE SECTION A-A).
10. THICKENED EDGE SLAB IS USED IN WALKWAYS WHERE NO FROST ACTION OCCURS & SOIL CONDITIONS PERMIT. WHERE FROST ACTION OCCURS & SOIL CONDITIONS DO NOT PERMIT CONSULT LOCAL BUILDING CODES FOR REQUIRED FOOTING DESIGN.

FALSE BEAM DETAIL

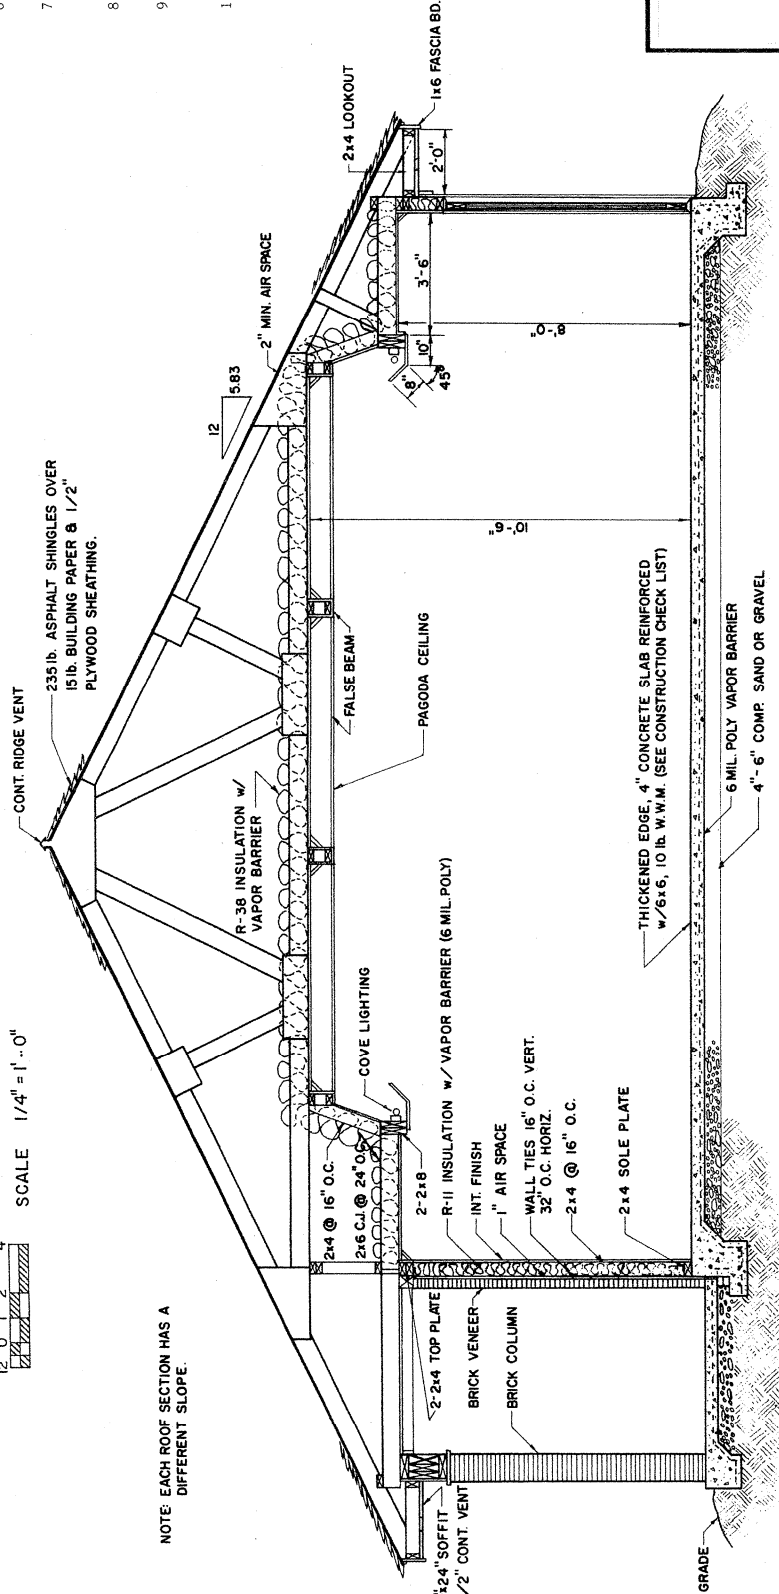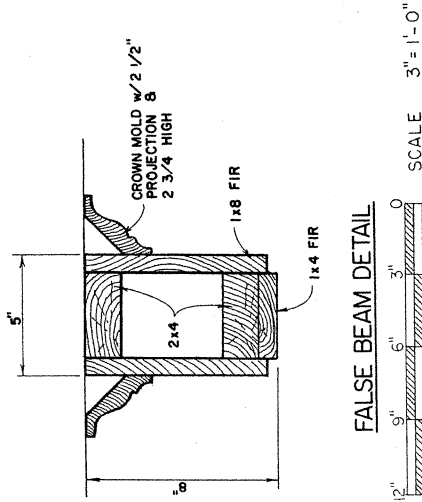

SECTION A-A

SCALE 3/8" = 1'-0"



SPACIOUS LIVING

MS 1985	7259	SHEET 4 OF 4
---------	------	--------------