


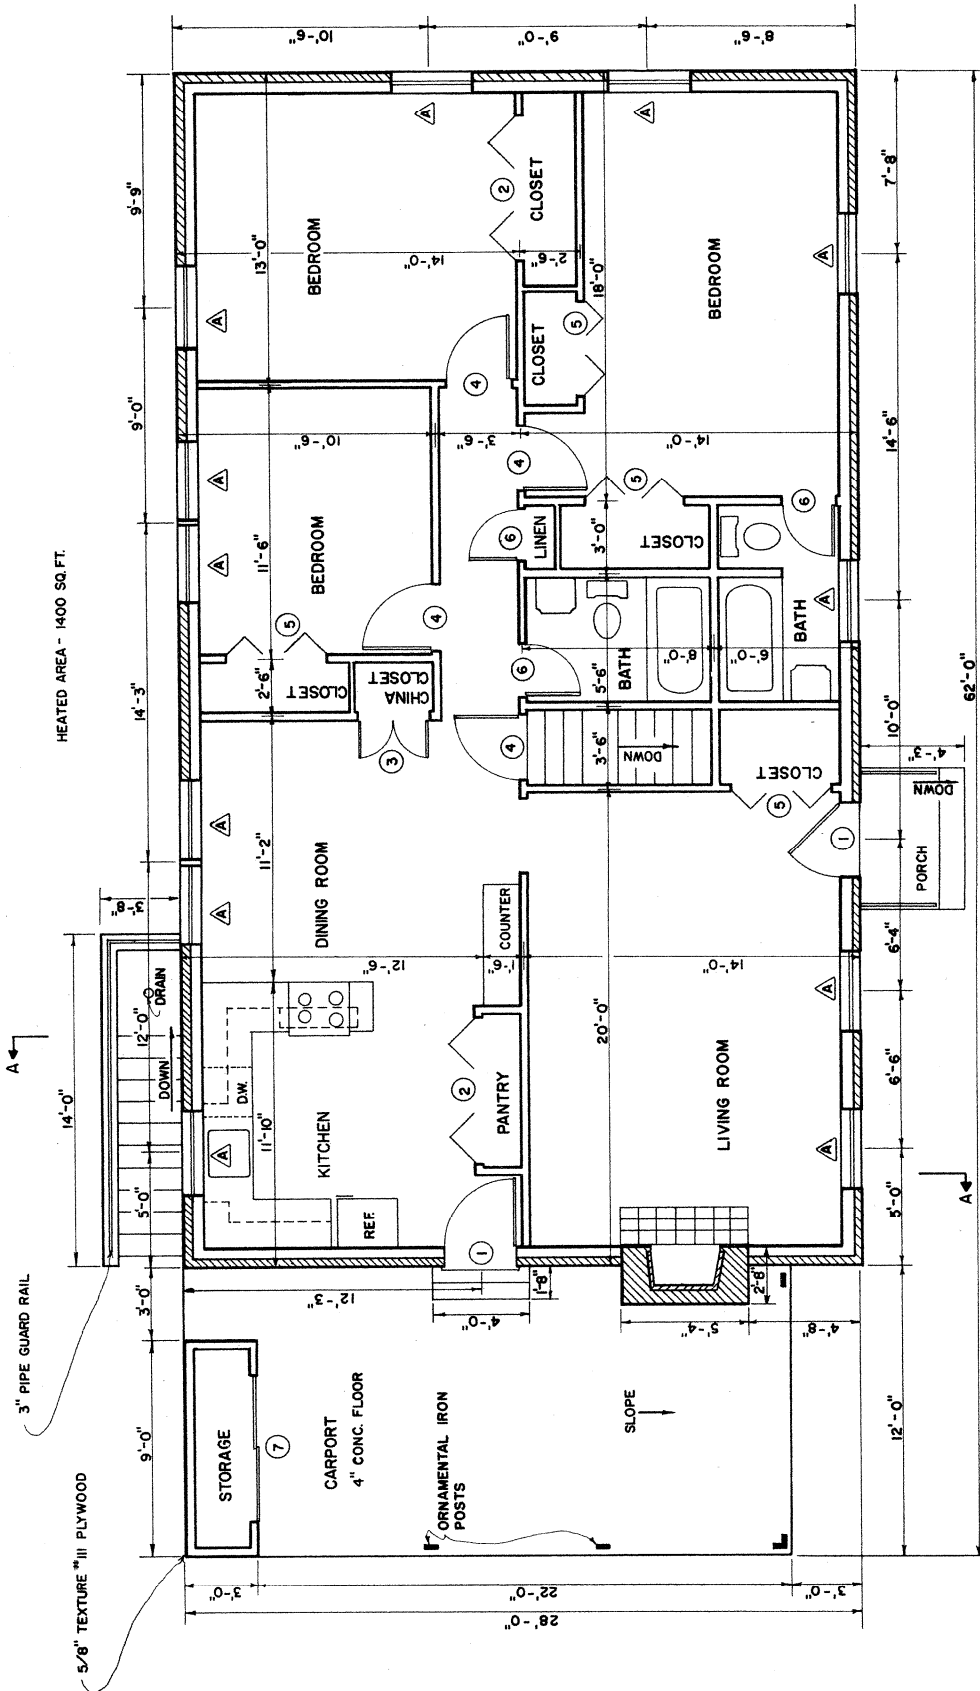

FLOOR PLAN SCALE 1/4" = 1' - 0"

CONSTRUCTION CHECK LIST

- CHECK LOCAL BUILDING CODE AND LOAN COMPANY CRITERIA. PURCHASED TRUSSES SHOULD MEET LOCAL SNOW LOAD CRITERIA.
- ADEQUATELY NAIL AND ANCHOR JOINTS.
- SEATH CORNERS WITH 1/2" PLYWOOD OR HIGH DENSITY FIBERBOARD OR USE DIAGONAL BRACING.
- USE EXTERIOR GLUED PLYWOOD WHEREVER IT MAY BE WETTED DURING OR AFTER CONSTRUCTION.
- PRESSURE TREAT ALL WOOD WITH GROUND CONTACT AND PROVIDE OTHER NEEDED TERMITE CONTROL.
- R VALUES DEPEND ON LOCAL CLIMATE AND FUEL COSTS.
- PROVIDE 1 SQ FT OF ATTIC VENT OPENINGS FOR EACH 150 SQ FT OF CEILING.
- WEATHERIZE ALL OPENINGS AND JOINTS.
- DOUBLE JOISTS UNDER TUBS AND OTHER HEAVY LOADS.

WINDOW SCHEDULE			
MARK	SIZE	DESCRIPTION	NO. REQ'D
A	3'-4" x 4'-0"	DOUBLE HUNG INSULATED GLASS	12
B	2'-11" x 1'-6 1/8"	BASEMENT INSULATED GLASS	7

DOOR SCHEDULE		
MARK	SIZE	NO. REQ'D
1	2'-0" x 6'-0"	EXTERIOR DOOR
2	3'-0" x 6'-0"	FOLDING DOOR
3	1'-3" x 6'-0"	GLASS PANELED DOOR
4	2'-3" x 6'-0"	INTERIOR FIBER BOARD
5	4'-0" x 6'-0"	FOLDING DOOR
6	2'-0" x 6'-0"	INTERIOR FIBER BOARD
7	3'-0" x 6'-0"	SLIDING DOOR



