




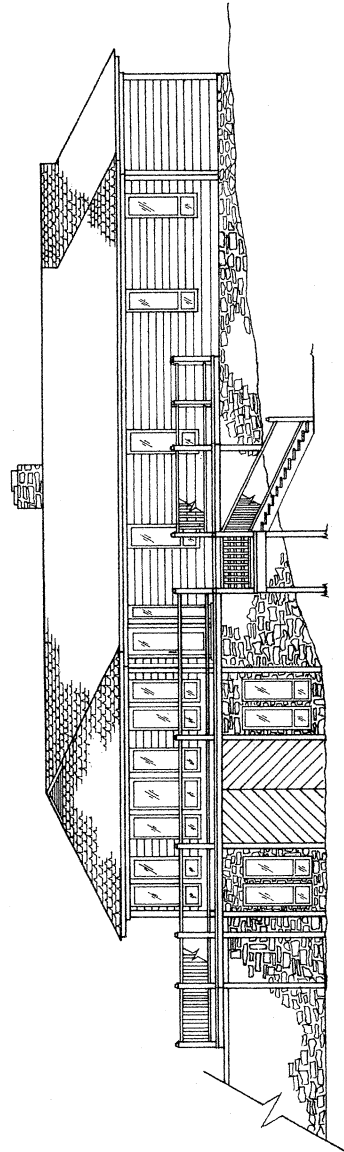

SOUTH ELEVATION

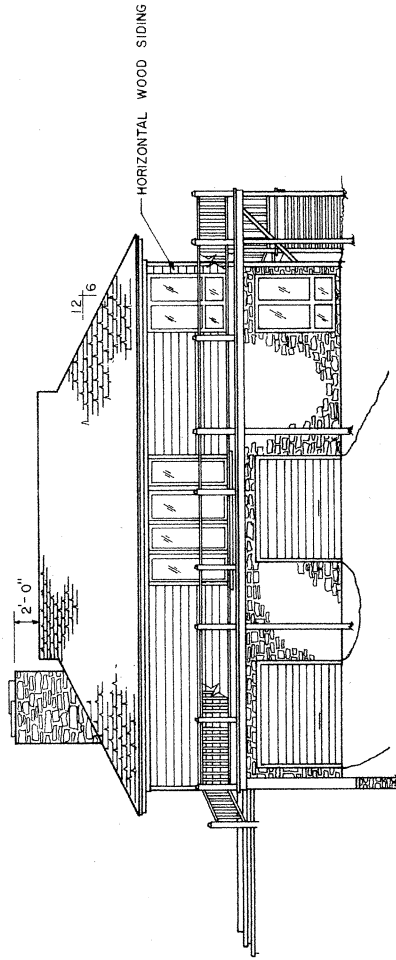


WEST ELEVATION

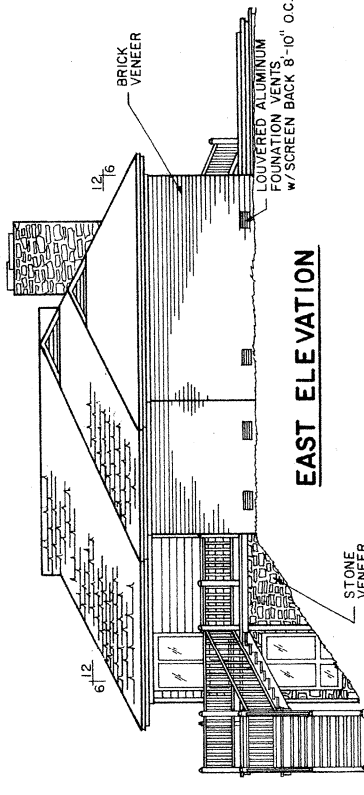


EAST ELEVATION

ALL ELEVATIONS
 12'0" 4' 11"
 SCALE 1/8" = 1' - 0"

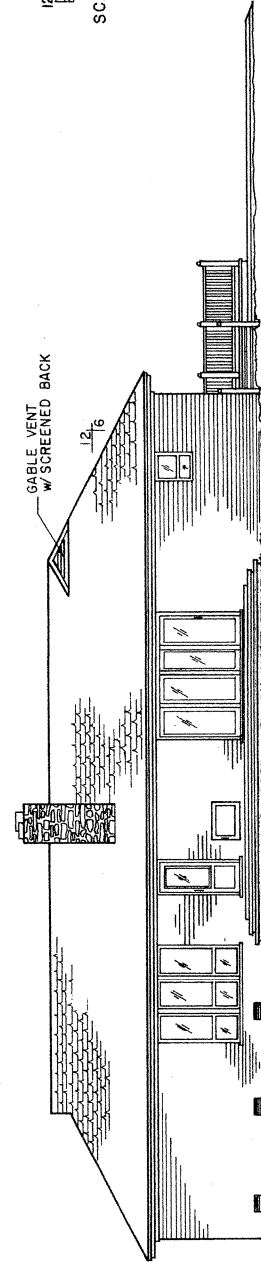

NORTH ELEVATION

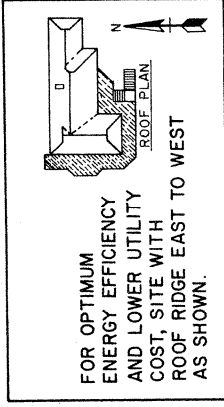


FOR OPTIMUM
 ENERGY EFFICIENCY
 AND LOWER UTILITY
 COST, SITE WITH
 ROOF RIDGE EAST TO WEST
 AS SHOWN.

LSU
AgCenter
 Research & Extension

THREE BEDROOM
 ENERGY EFFICIENT HOUSE

MISS. '81 7240 SHEET 1 OF 5

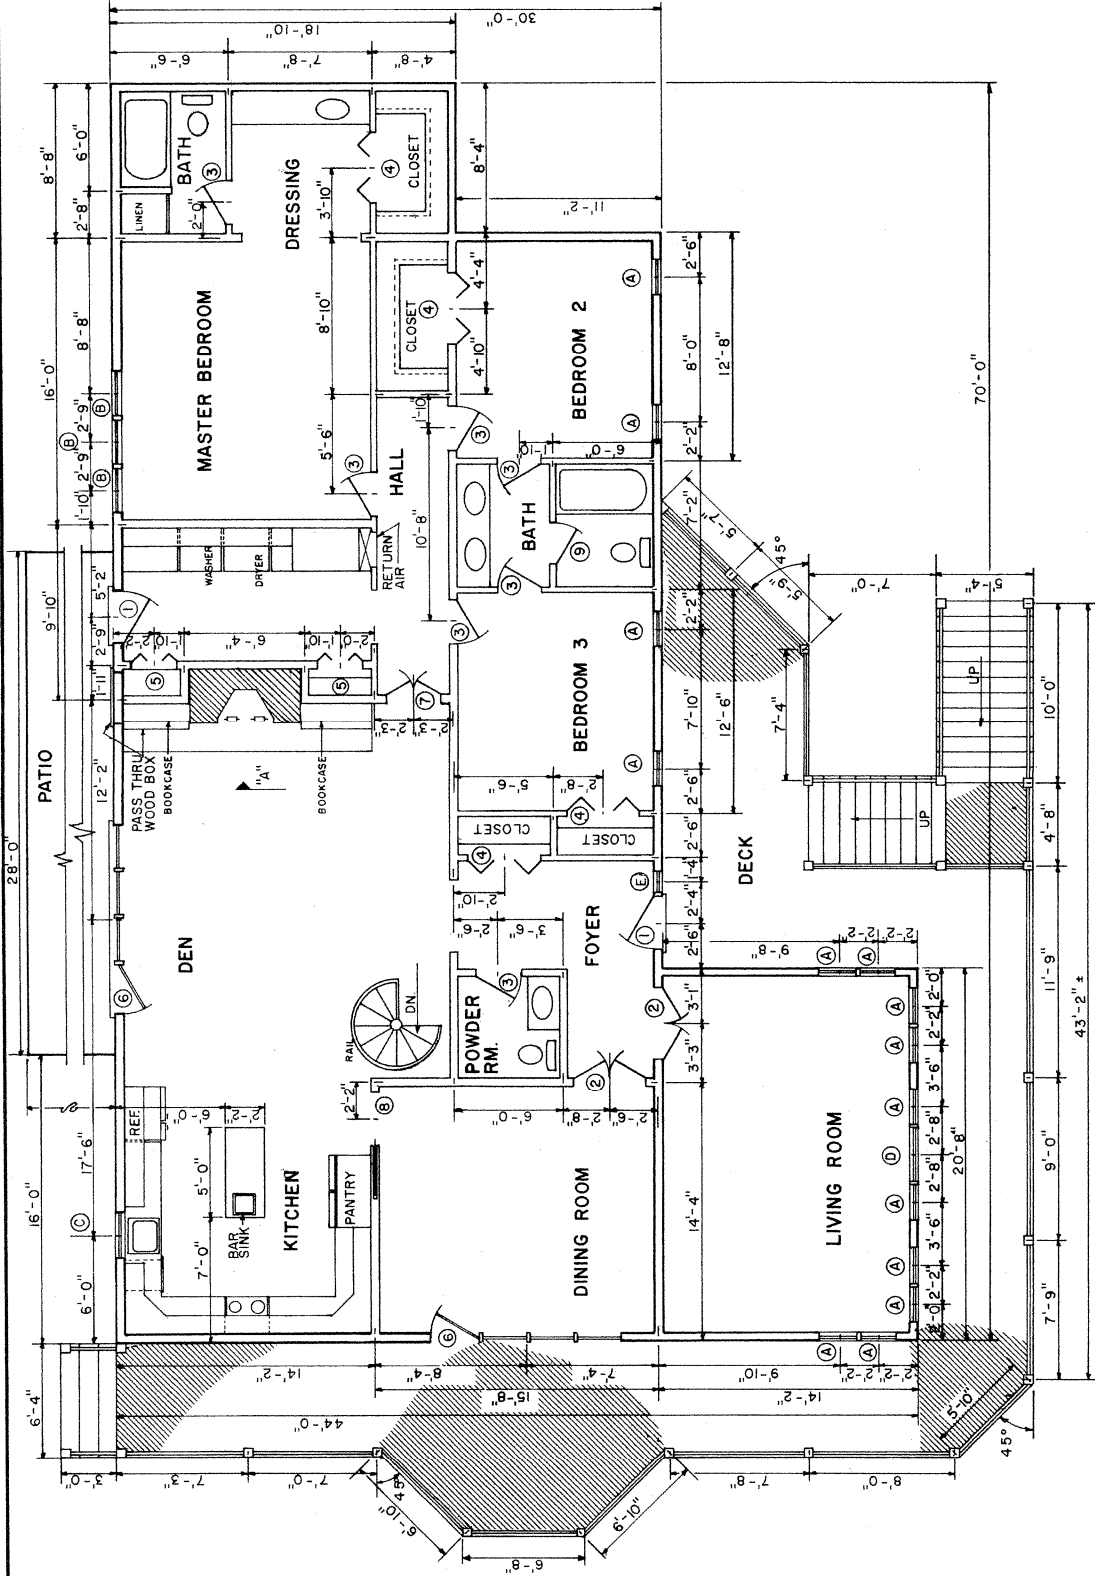

FIRST FLOOR PLAN

SCALE 3/16" = 1'-0"

DOOR SCHEDULE			
SYMBOL	SIZE	DESCRIPTION	QTY.
1	3'-0"x6'-8"	EXT. W/MULTI-LITE TOP	4
2	4'-0"x6'-8"	INT. BAT-WING	2
3	2'-6"x6'-8"	INT. PANEL DR.	7
4	4'-0"x6'-8"	BI-FOLD w/2 PANELS	4
5	2'-6"x6'-8"	"	2
6	10'-6"x6'-8"	ATRIUM DR.	2
7	3'-0"x6'-8"	INT. BAT-WING	1
8	3'-0"x6'-8"	INT. POCKET DR.	1
9	2'-4"x6'-8"	INT. PANEL DR.	1
10	9'-0"x7'-0"	GAR. DR. 2DR. OPN.	2
11	2'-6"x6'-8"	EXT. DR. w/MULTI-LITE TOP	1
12	3'-0"x6'-8"	"	1
13	4'-0"x6'-8"	EXT. DOUBLE DR.	1

ALL EXTERIOR DOORS SHALL BE STEEL CLAD WITH INSULATED CORES

WINDOW SCHEDULE			
SYMBOL	SIZE	DESCRIPTION	QTY.
A	2'-0"x6'-0"	PICTURE AWNING	22
B	2'-6"x6'-8"	"	3
C	2'-6"x3'-0"	"	1
D	3'-0"x6'-0"	PICTURE AWNING	1
E	1'-2"x6'-8"	SIDE LITE	1





ALL WINDOWS SHALL BE CERTIFIED DOUBLE GLAZED WITH ALUMINUM FRAME.




1. CONSULT LOCAL BUILDING CODES AND LENDING AUTHORITIES BEFORE BEGINNING CONSTRUCTION.
2. ACTUAL FOOTING SIZE AND SIZE AND AMOUNT OF ALL REINFORCEMENT DEPENDS ON SOIL CONDITIONS AND PROPERTIES.
3. ADEQUATELY NAIL AND ANCHOR JOINTS.
4. SHEATH CORNERS WITH 1/2" PLYWOOD OR HIGH DENSITY FIBERBOARD OR USE DIAGONAL BRACING.
5. USE EXTERIOR GLUED PLYWOOD WHEREVER IT MAY BE NEEDED DURING OR AFTER CONSTRUCTION.
6. PRESSURE TREAT ALL WOOD WITH GROUND CONTACT AND PROVIDE OTHER NEEDED TERMITE CONTROL.
7. R VALUES DEPEND ON LOCAL CLIMATE AND FUEL COST.
8. PROVIDE 1 SQ FT OF ATTIC VENT OPENINGS FOR EACH 150 SQ FT OF CEILING.
9. NEAT-HERIZE ALL OPENINGS AND JOINTS.
10. ALL FILL SOIL SHALL BE COMPACTED TO 95% PROCTER.
11. PROVIDE LOUVERED ALUM. FOUNDATION VENTS W/SCREEN BACK 8'-10" O.C.(NOT SHOWN)
12. ALL EXTERIOR DECKS, POSTS AND RAILS SHALL BE PRESSURE TREATED FOR DECAL RESISTANCE AND FASTENED WITH RUST RESISTANT FASTENERS.



MISS. '81	7240	SHEET 3 OF 5
-----------	------	--------------




NOTE: BOTTOM OF FOOTINGS SHALL BE BELOW
FROST LINE AND BEARING ON UNDISTURBED
SOIL.

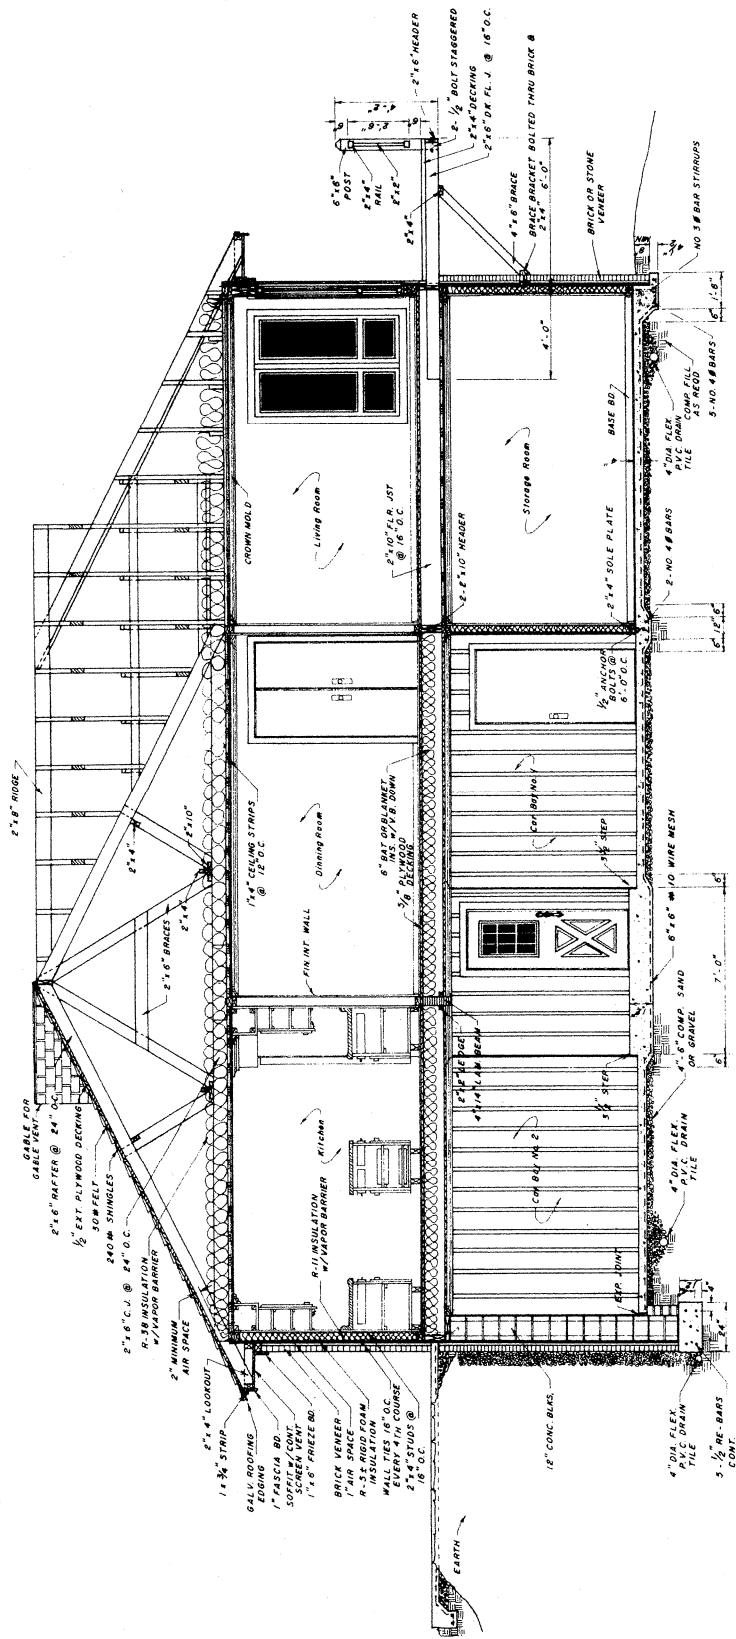

SECTION AA

12" 0' 1' 2' 4' SCALE 1/4" = 1' - 0"

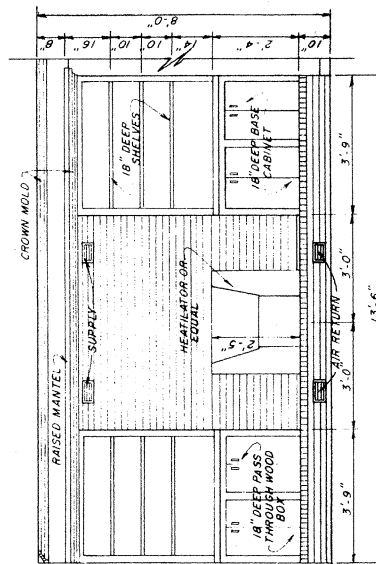

ELEVATION "A"

12" 6" 0' 1' 2' 3' SCALE 3/8" = 1' - 0"